



EasyFit Soft70 GEN2 Accent




2.76" (70mm) overall trimless diameter. Available with a separate installation kit with overlap flange or mud-in kit for seamless flush finish. Fixed version available. Supplied with a remote driver box and a plug and play tethered power supply.

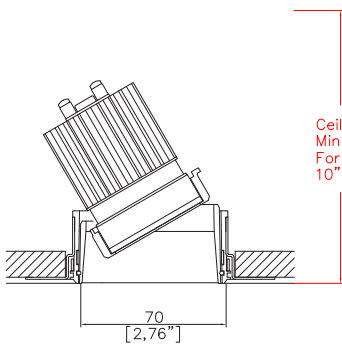

Soft70 Gen2 with Trimless Kit TL1⁽¹⁾ (front fitting, full skim)
Cut-out Ø3.26" (83mm).

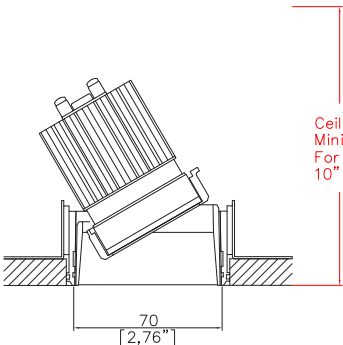

Soft70 Gen2 with Trimless Kit TL2⁽¹⁾ (rear fitting, partial skim)
Cut-out Ø3.22" (82mm).

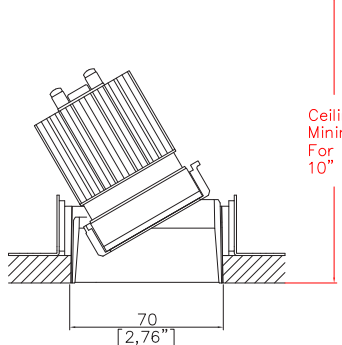

Soft70 Gen2 with Trimless Kit TL3⁽¹⁾ (rear fitting, solid ceiling)
Cut-out Ø2.75" (70mm).

LED Source	ALED51/3	ALED51/3	ALED51/3	ALED51/3
CCT	3000K	3000K	3000K	3000K
Drive Current	350mA	350mA	350mA	350mA
Power inc Driver	14.8W	14.8W	14.8W	14.8W
Beam Angle	SP (12°)	MF (19°)	FL (30°)	WFL (57°)
Delivered Lumens	1010	1058	1115	1213
Delivered Intensisty cd	12716	6983	3902	1519
Delivered Lumens per circuit watt	68	71	75	82
Forward Volt	36V	36V	36V	36V
CRI	≥90 CRI	≥90 CRI	≥90 CRI	≥90 CRI

Apply these factors to 3000K for lumen output of other CCTs: 2200K x 0.85 / 2400K x 0.89 / 2700K x 0.97 / 3500K x 1.01 / 4000K x 1.10.

Ceiling void minimum depth for driver box: 10.00" (254mm)

Project Ref: _____ Location Ref: _____

Specify fixture part number (All boxes must be filled in to correctly order)

ASF70210				0	ALED51/3			ALEZ1-120-277		
----------	--	--	--	---	----------	--	--	---------------	--	--

Installation _____

TL1 Trimless for full skim
TL2 Trimless for partial skim ceilings (0.2"-0.87" total thickness)
TL3 Trimless for solid ceilings (0.2"-0.87" total thickness)
TL4 Trimless for partial skim ceilings (1"-1.18" total thickness)
TL5 Trimless for solid ceilings (1"-1.18" total thickness)

Finish _____

WH03 White RAL9016
BK01 Black RAL9005
RAL Custom*
ABR1 Antique Brass
ABZ1 Antique Bronze

Location _____

WT Wet
Supplied for dry location as standard

LED Type _____

ALED51/3 LED50 ONE GEN3

CCT _____

- 22 2200K (1)
 - 24 2400K (1)
 - 27 2700K
 - 30 3000K
 - 35 3500K (1)
 - 40 4000K (1)
- (1) contact Lucent for availability

Beam Angles _____

SP Spot
MF Medium Flood
FL Flood
WFL Wide Flood

EasyFit _____

ALEZ1-120-277 Lucent EasyFit 120-277V


Dimming Protocol _____

SLA EldoLED Analog (0-10V) (0.1% Dimming)
ECA EldoLED Analog (0-10V) (1% Dimming)
SLD EldoLED DALI (0.1% Dimming)
ECD EldoLED DALI (1% Dimming)
PTB15 ERP PTB 0-10V/Phase (1% Dimming) (PHASE ONLY 120V)
FTX15 Hatch Foundation 0-10V/Phase (1% Dimming)

Contact Lucent factory for Lutron LED Driver options

Louvre/Lens _____


XX Not required
LL45 Honeycomb
LLDF Solite/Diffusing
LLFR Frosted Lens
LLLS Linear Spread
LLHS Heavy Spread






NIC - No contact with insulation

Ceiling void minimum depth for driver box: 10.00" (254mm)

Fixture and EasyFit driver box

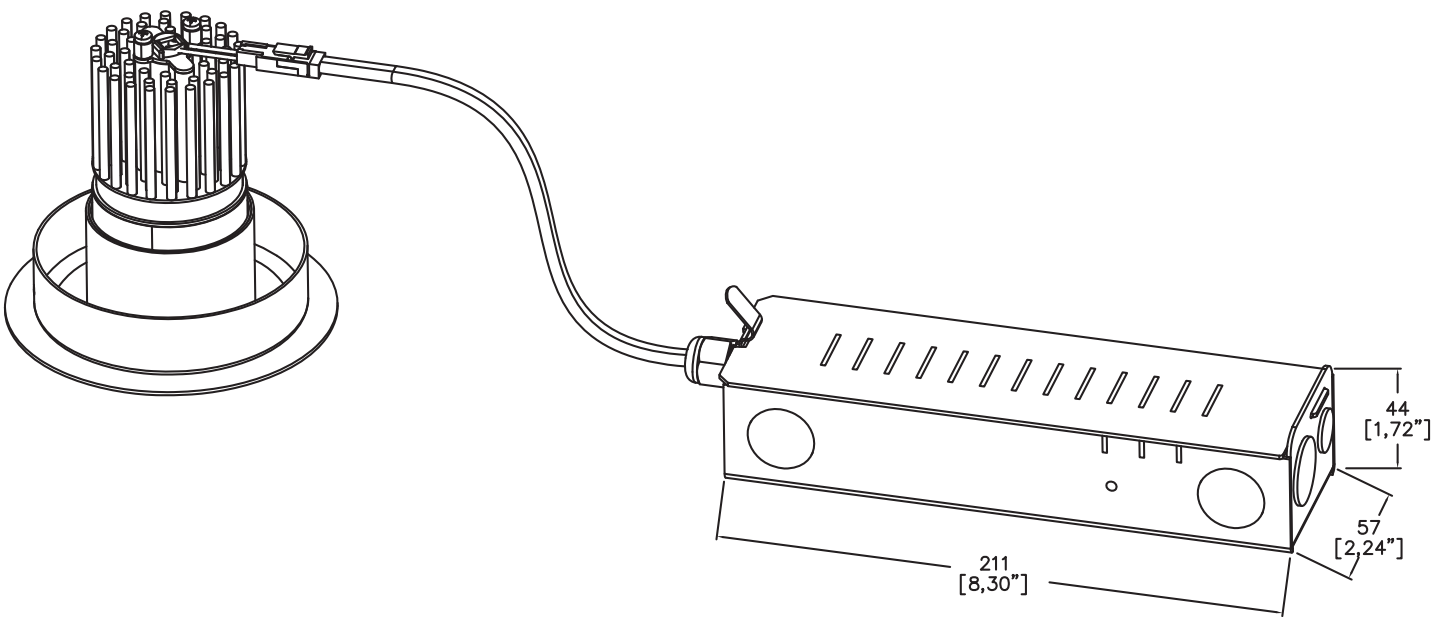

Installation Kits



TL1 Trimless Kit, full skim TL2 Trimless Kit, partial skim TL3 Trimless Kit, solid ceiling

Damp/wet rated fixture



When supplied as wet rated an additional ring is installed at the aperture with a clear glass

Ceiling void minimum depth for driver box: 10.00" (254mm)

Finish selection




Antique Brass




Antique Bronze

Accessories




Honeycomb Louvre



Diffusing Lens



Frosted Lens



Heavy Spread Lens



Linear Spread Lens

Technical Details

*Custom RAL code must be specified. Custom RAL colours can increase prices and lead times

Dimming. Whilst Lucent can offer the majority of its luminaires with various dimming options, it remains the responsibility of the specifier/installer to check and ensure compatibility of any control equipment used. Additional cabling may be required depending on the dimming protocol specified.

^ Depth indicated is the minimum recess depth for the driver to be installed through the luminaire cut out.

First Fix Requirement. Luminaire comprised of fixture body with ceiling trim and installation kit, which is to be fitted into the ceiling once finished. Ensure correct alignment of the installation kit before final assembly (see luminaire installation instructions for details)

Location. Tested from underside of the ceiling

It is the policy of Lucent Lighting to continually review and improve its products and therefore reserve the right to change any details of product or withdraw specifications without prior notice.

This specification sheet supersedes all previous versions.

All intellectual property rights pertaining to the product described above and to this document are owned by or licensed to Lucent Lighting Ltd.

We reserve the right to take whatever action is necessary to protect those intellectual property rights.

Please notify Lucent Lighting Ltd of any inaccuracies immediately. E&OE

