

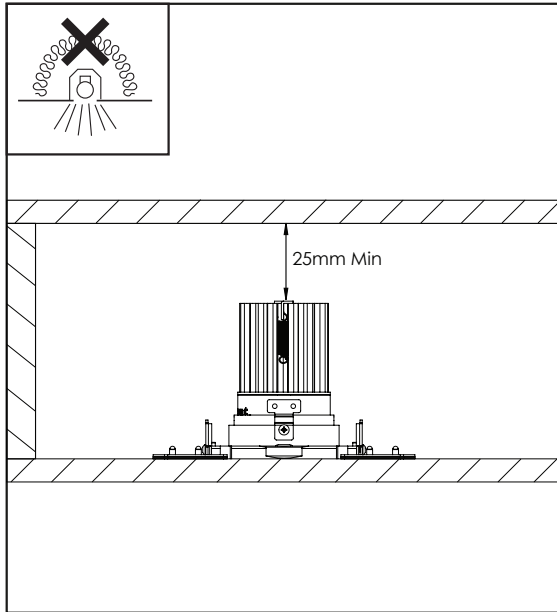


Installation Instructions for fitting with trim kit (TL)


For luminaires 750-LED/753-LED

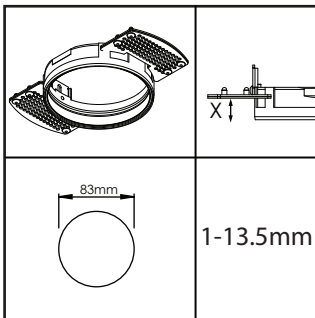


Do not cover fixture with insulation material.

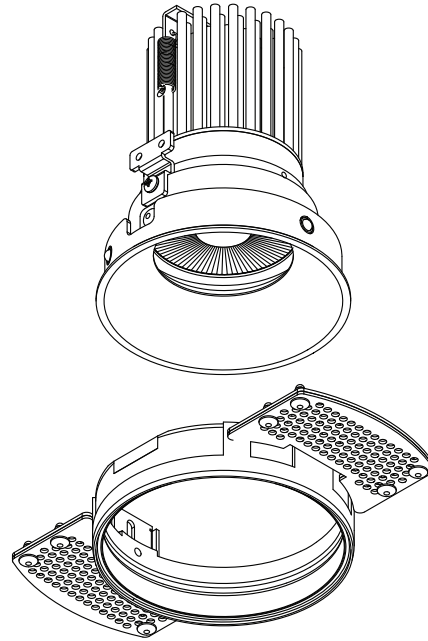


1. Plus Mini TL kit cutout size. Make sure legs are set to correct height for ceiling thickness.

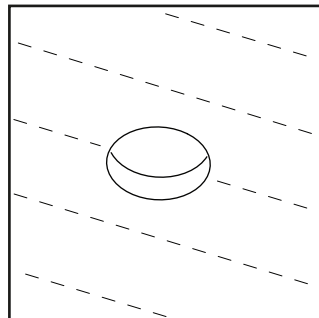


2. Prepare cutout in surface

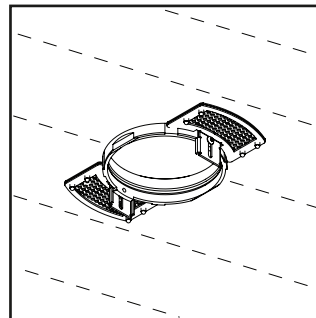


3. Insert TL kit upside down into cutout and mark the location of the mesh holes.

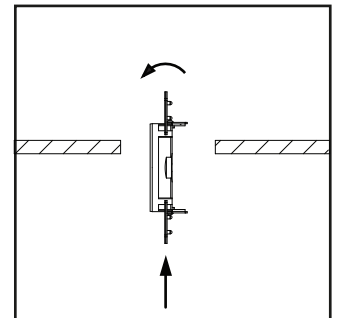


4. Insert TL kit into cutout by lifting and rotating as shown.

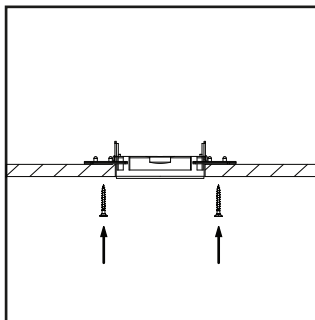


5. Screw TL kit to ceiling using the marks made previously as a guide.

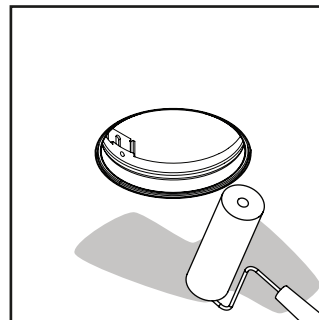

6. Plaster-in the TL kit and finish the ceiling.

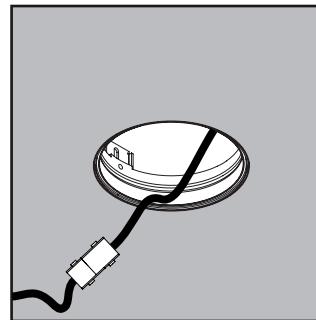


7. Connect fitting to driver.

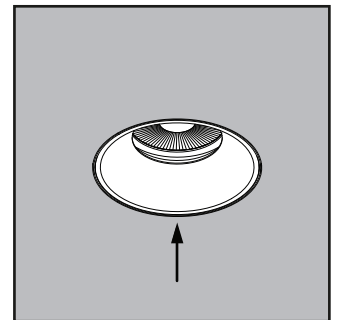


8. Insert Fixture into TL kit.


Fixture Adjustment Instructions

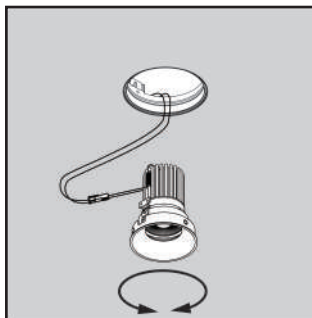

1. Remove fixture from trimless kit and adjust rotation

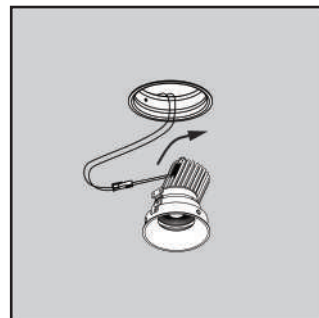


2. Adjust tilt

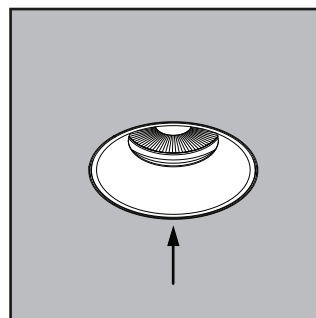


3. Replace fixture in trim kit

LED Modules Instructions


Installation and servicing of Lucent LED modules should always be carried out by a qualified and compitant person, in conjunction with these instructions for the LED modules and the particular Lucent light fittings instructions.
For further information or assistance contact Lucent Lighting.




Switch off mains power before installation or servicing.




Do not cover luminaire & LED module with insulation material.



Lucent LED modules are all insulation class III. Drivers used must have an output not exceeding voltage for SELV (<60Vdc)




LED lead, if damaged, lead cannot be replaced, the LED module is to be replaced.

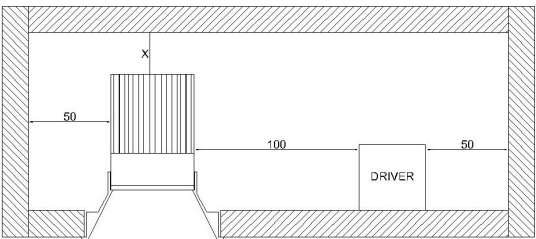


Leave the minimum distancies detailed above around the luminaire and driver.
X = LED35 modules, min. 15mm
LED51 modules min. 25mm
LED71 modules min 25mm
Note some driver and fitting combinations may require a bigger recess depth to install driver.

Servicing LED modules.

Lucent LED modules are not user replaceable. LED modules should only be replaced a qualified person, the manufacturer or a similar qualified person.




Switch off mains power.
Disconnect LED module from the driver.
Take off the fixing brace by removing the hooked spring to free the LED module.

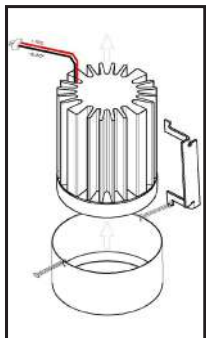


Remove the LED module.
Reverse process to re-install the LED module and re-connect to the driver before turning on the mains power.

LED Module	Drive Current	Typ. forward volt	Mod. Power
LED35/2 LED35/U	350mA max.	18vdc	6.3w max.
LED51/2 LED51/U	350mA max	33vdc	11.6w
LED71 - LED71/U	700mA max	33vdc	23.1w
LED51WD	500mA	29.1vdc	15.6w
LED51TW	700mA	18.4vdc per Ch.	12.6w max. per CH.
LED71WD	1000mA	23.0vdc	23.0w
LED71TW	1000mA	23.4vdc per Ch.	23.4w max. per Ch.

All LED drivers supplied by Lucent will be pre-wired with a lead that has the correct connector to match the LED module used.
If connectors removed, warranty will be void.
If the driver needs to be replaced, or cables extened refer to following wiring diagrams.

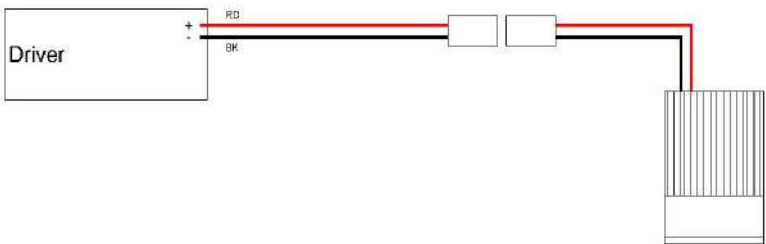

For LED35/2, LED51/2, LED71, ULTRA & LED51WD, LED71WD.
Refer to specific driver connections for the exact driver terminals configuration.

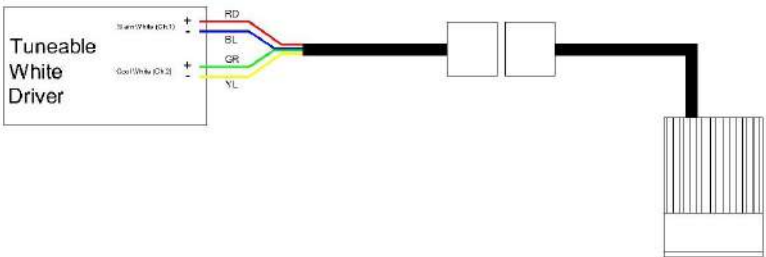

For LED51TW & LED71TW
Refer to specific driver connections for the exact driver terminals configuration.